
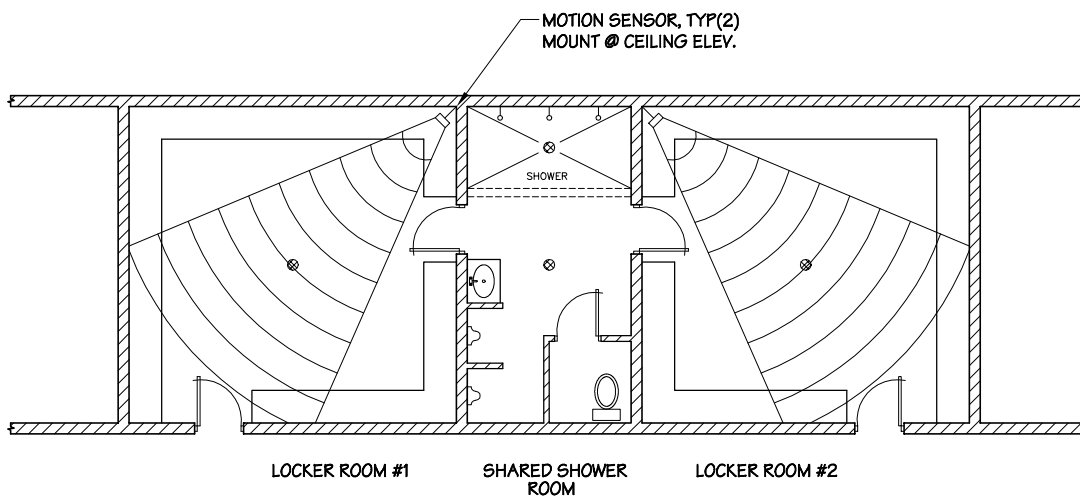


MOTION SENSOR CONTROL DIAGRAM

LOCKER ROOM HEATING, VENTILATION, & LIGHTING

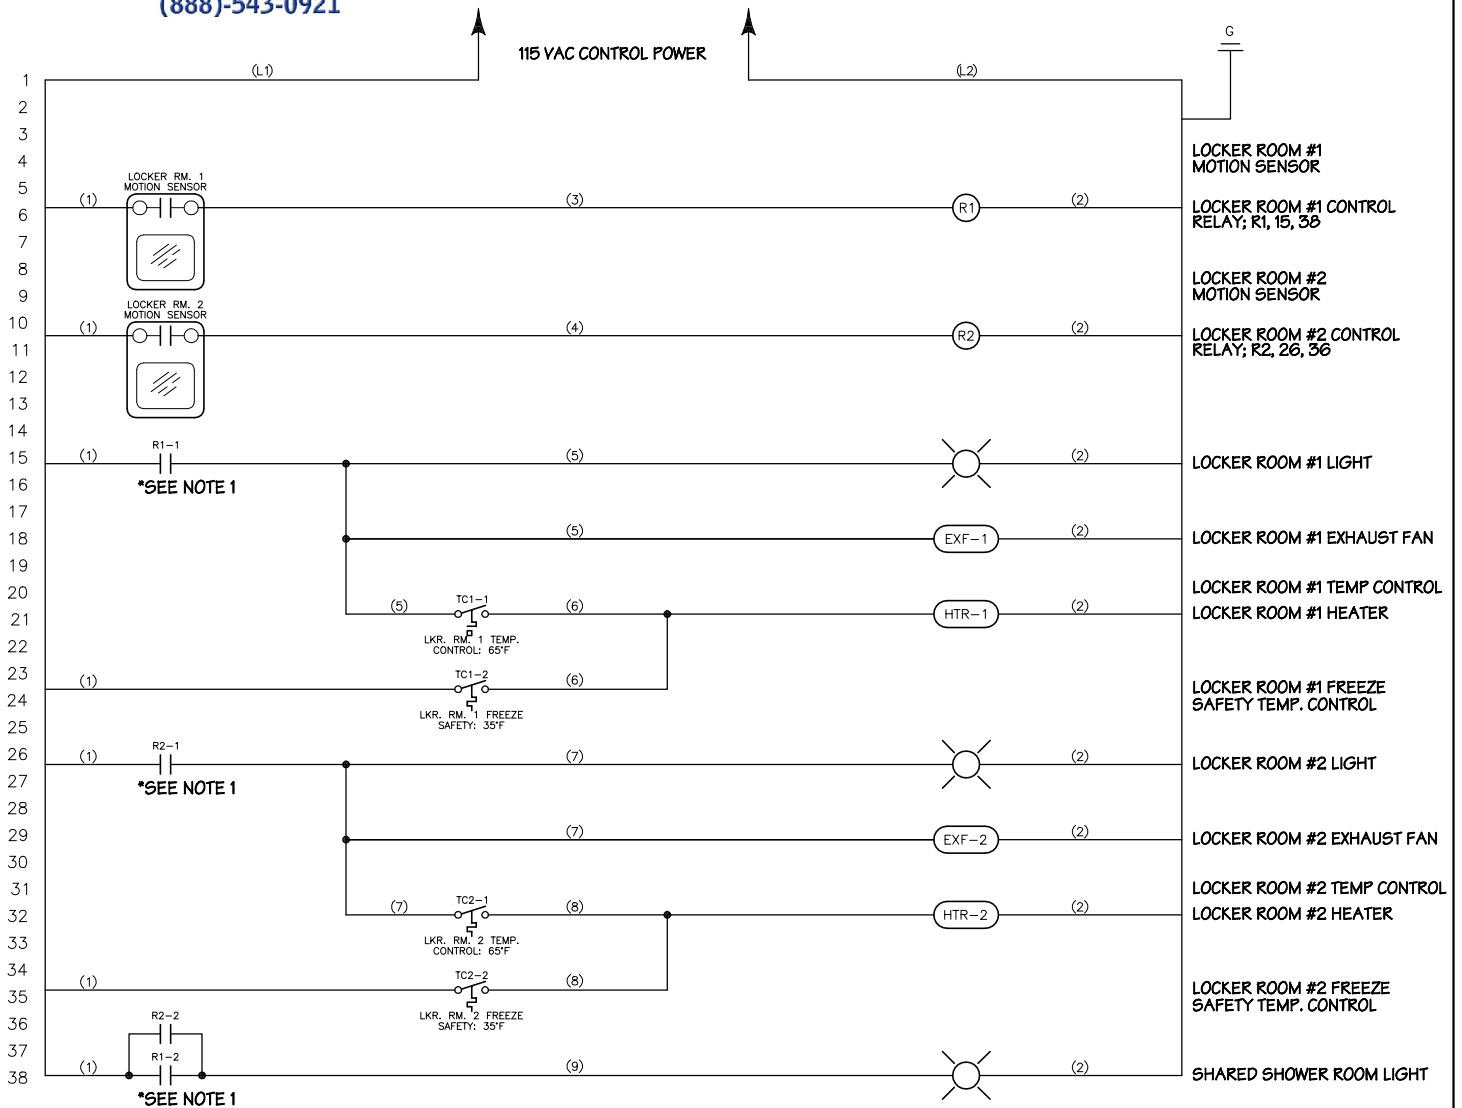

NOTE 1: FOR 277 VAC APPLICATIONS, R1 & R2 MUST BE 3 POLE RELAYS FOR REQUIRED ADDED CONTROL VOLTAGE CONTACTS.